

PRODUCT RANGE SPECIFICATION

B34681(TC-1950) – Wall-Mounted Triple-Bowl Medical Wash Basin

DOCUMENT SCOPE	DOCUMENT REFERENCE	DATA STATUS	GENERATED ON
Product range	B34681(TC-1950){PSS}	Published catalogue data	14 Sep 2026

01 Product description and specification

Product description	Wall-mounted triple-bowl medical basin for clinical handwashing areas requiring three adjacent basins. Available in both 1.2 mm and 1.5 mm thick Grade 304 stainless steel construction, this triple-bowl basin delivers exceptional durability, superior corrosion resistance, and uncompromising hygiene standards essential for healthcare settings. This purpose-built medical basin features three generously proportioned centre-oriented bowls, each measuring 450 mm (L) x 400 mm (W) x 250 mm (D), arranged across a substantial 1950 mm length to accommodate multiple users simultaneously. Engineered for secure wall-mounted installation, the basin comes complete with heavy-duty gallows brackets that ensure stability and optimal space efficiency in clinical environments. Each bowl features a standard 40 mm waste outlet for efficient drainage, preventing water accumulation and maintaining hygienic conditions.
Short Form Specification	SPECIFICATION USE Use this description when specifying this product range. Basterfield B34681(TC-1950). Wall-Mounted Triple-Bowl Medical Wash Basin. Material Thickness: 1.2 mm, 1.5 mm. Each bowl features a standard 40 mm waste outlet for efficient drainage, preventing water accumulation and maintaining hygienic conditions.

02 Models and configurations


MODEL	DESCRIPTION	PUBLISHED CONFIGURATION
B34681(TC-112-1950)	B34681(TC-112-1950) Medical Basin Triple Bowl Wall Mounted Stainless Steel 1.2mm Thickness Material Thickness: 1.2.	Material Thickness: 1.2 mm
B34681(TC-115-1950)	B34681(TC-115-1950) Medical Basin Triple Bowl Wall Mounted Stainless Steel 1.5mm Thickness Material Thickness: 1.5.	Material Thickness: 1.5 mm

03 Application information


Intended applications	Hands-Free Handwashing (Knee/Elbow/Foot Operated)
Industries	Hospitals & Clinics, Research Laboratories

Typical lead time	10–15 working days
Warranty	12 months

Product drawings and images

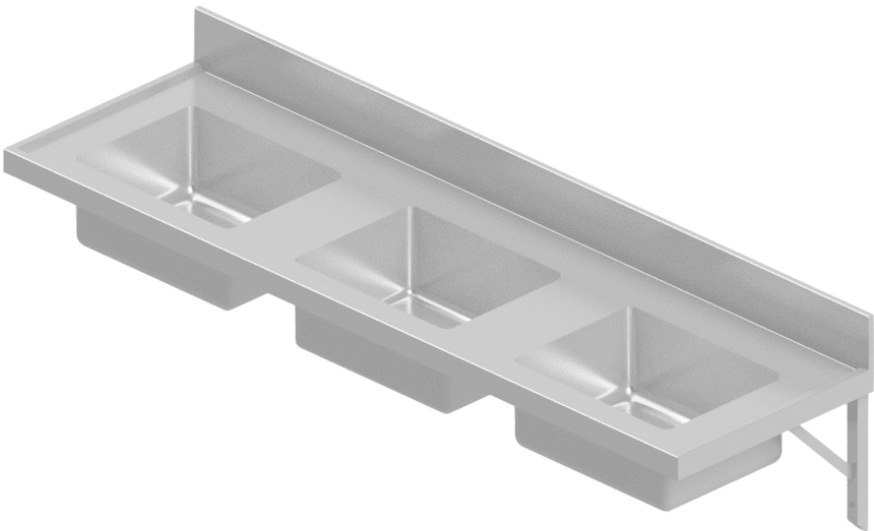

PRODUCT IMAGE

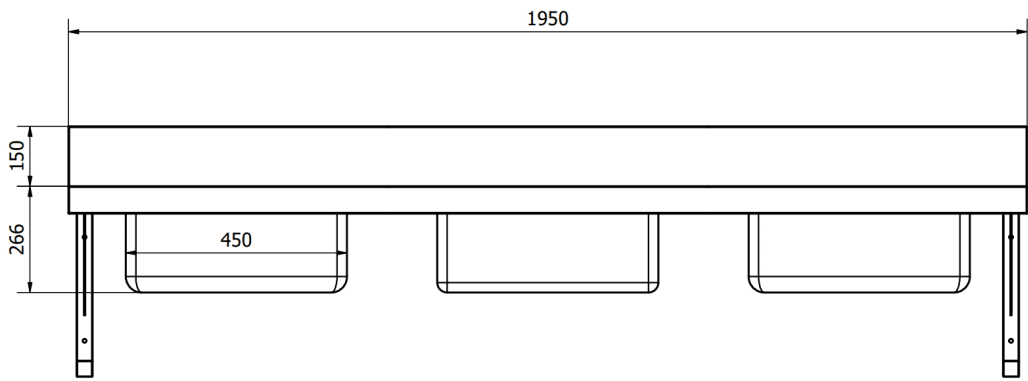

FRONT

PRODUCT IMAGE

VERIFICATION REQUIRED Published values are provided for initial specification. Confirm the selected model, critical dimensions, site services, clearances, and the latest document revision with Basterfield before procurement, manufacture, or installation. E&OE. Specifications are subject to change without notice.