

PRODUCT RANGE SPECIFICATION

H22681(SC) – Single Bowl Medical Sink



PRODUCT IMAGE

① Product image is representative of the range and may not reflect the actual item.

DOCUMENT SCOPE Product range	DOCUMENT REFERENCE H22681(SC){PSS}	DATA STATUS Published catalogue data	GENERATED ON 3 Oct 2026
---------------------------------	---------------------------------------	---	----------------------------

01 Product description and specification

Product description	The H22681(SC) is a wall-mounted single-bowl medical sink for hospitals, clinics, healthcare utility rooms and laboratory washing areas. It is manufactured from Grade 304 stainless steel with a brushed finish. The sink has one centre-oriented bowl. A marine edge helps contain water on the sink top, and a 150 mm rear splashback protects the wall behind the sink. A dedicated landing provides space for tapware. Gallows brackets are included for wall mounting. Each bowl has a pre-punched hole for a 1½-inch BSP waste fitting. Dura 817 waste fittings and the Borrás medical mixer with wall and deck mounting kit are available as optional accessories and are supplied separately from the sink. Overall dimensions and material thickness are specified by the selected item configuration.
Short Form Specification	SPECIFICATION USE Use this description when specifying this product range. Basterfield H22681(SC) single-bowl medical sink in Grade 304 stainless steel with a brushed finish, with one centre-oriented bowl, marine edge, 150 mm rear splashback, tapware landing and included gallows brackets for wall mounting. Each bowl to have a pre-punched hole for a 1½-inch BSP waste fitting. Overall size, material thickness and bowl dimensions to match the selected item configuration. Waste fittings and medical mixer excluded from the standard sink.

02 Technical specifications

PARAMETER	VALUE	UNIT	TECHNICAL NOTE
Material	Stainless Steel Grade 304	—	The primary material used in the construction of the item. Certain components may be manufactured from different materials.
Number of Bowls	1	—	—
Bowl Orientation	Centre	—	—
Bowl Length	450	mm	The length of the bowl typically as measured from left to right.

02 Technical specifications

PARAMETER	VALUE	UNIT	TECHNICAL NOTE
Bowl Width	400	mm	—
Bowl Depth	250	mm	—
Splashback Height	150	mm	Height of the splashback above the tabletop or working surface.
Mounting Type	Wall Mounted	—	—
Drainage	Dura waste outlet optional; not included	—	—
Finish	Brushed Stainless Steel	—	—
Waste Connection	Pre-punched hole for 1½-inch BSP waste fitting	—	—
Tapware Supply	Borras medical mixer optional; not included	—	—

03 Models and configurations

MODEL	DESCRIPTION	PUBLISHED CONFIGURATION
H22681(SC-112-0650)	Medical Sink, Grade 304 Stainless Steel, 1.2mm Thick, 650mm (L) x 650mm (W), with 450mm (L) x 400mm (W) x 250mm (D) Centre-Oriented Bowl, Brushed Finish, Marine Edge, 150mm Rear Splashback, Dedicated Tapware Landing, Wall Mounting with Included Gallows Brackets and Pre-Punched Hole for a 1½-inch BSP Waste Fitting, Optional Dura 817 Waste Outlet and Borras Medical Mixer with Wall and Deck Mounting Kit Not Included	Length: 650 mm Width: 650 mm Overall dimensions: 650 × 650 × — mm (L × W × H)

04 Functional features

01	Grade 304 Stainless Steel Grade 304 stainless steel construction with a brushed finish. Material thickness is specified by the selected configuration.
02	Centre-Oriented Bowls One centre-oriented bowl. Bowl dimensions are listed with each configuration.
03	Marine Edge and Splashback Marine edge to help contain water, with a 150 mm rear splashback.
04	Wall Mounting Brackets Included Supplied with gallows brackets for wall-mounted installation.
05	Dedicated Tapware Landing Landing provides space for separately selected tapware.
06	Pre-Punched Waste Holes Each bowl has a pre-punched hole for a 1½-inch BSP waste fitting. Waste fittings are selected separately.

05 Application information


Intended applications	General Handwashing, Healthcare Utility Rooms, Hospital Sinks, Laboratory Work Areas
-----------------------	--

Industries	Clinical Laboratories, Hospitals & Clinics, Research Laboratories
------------	---

06 Supply and support

Typical lead time	10–15 working days
Warranty	24 months

Product drawings and images

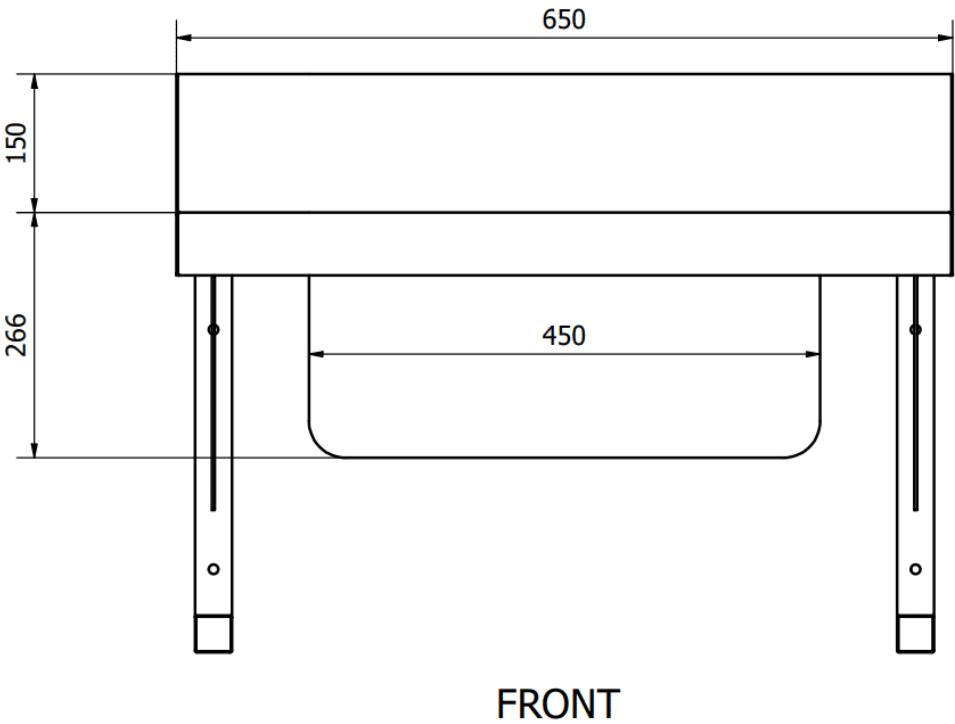

PRODUCT IMAGE

VERIFICATION REQUIRED Published values are provided for initial specification. Confirm the selected model, critical dimensions, site services, clearances, and the latest document revision with Basterfield before procurement, manufacture, or installation. E&OE. Specifications are subject to change without notice.